




**Burnley College
Lancs, UK
Heat Pump
BallICE
Application**

Schematic Layout

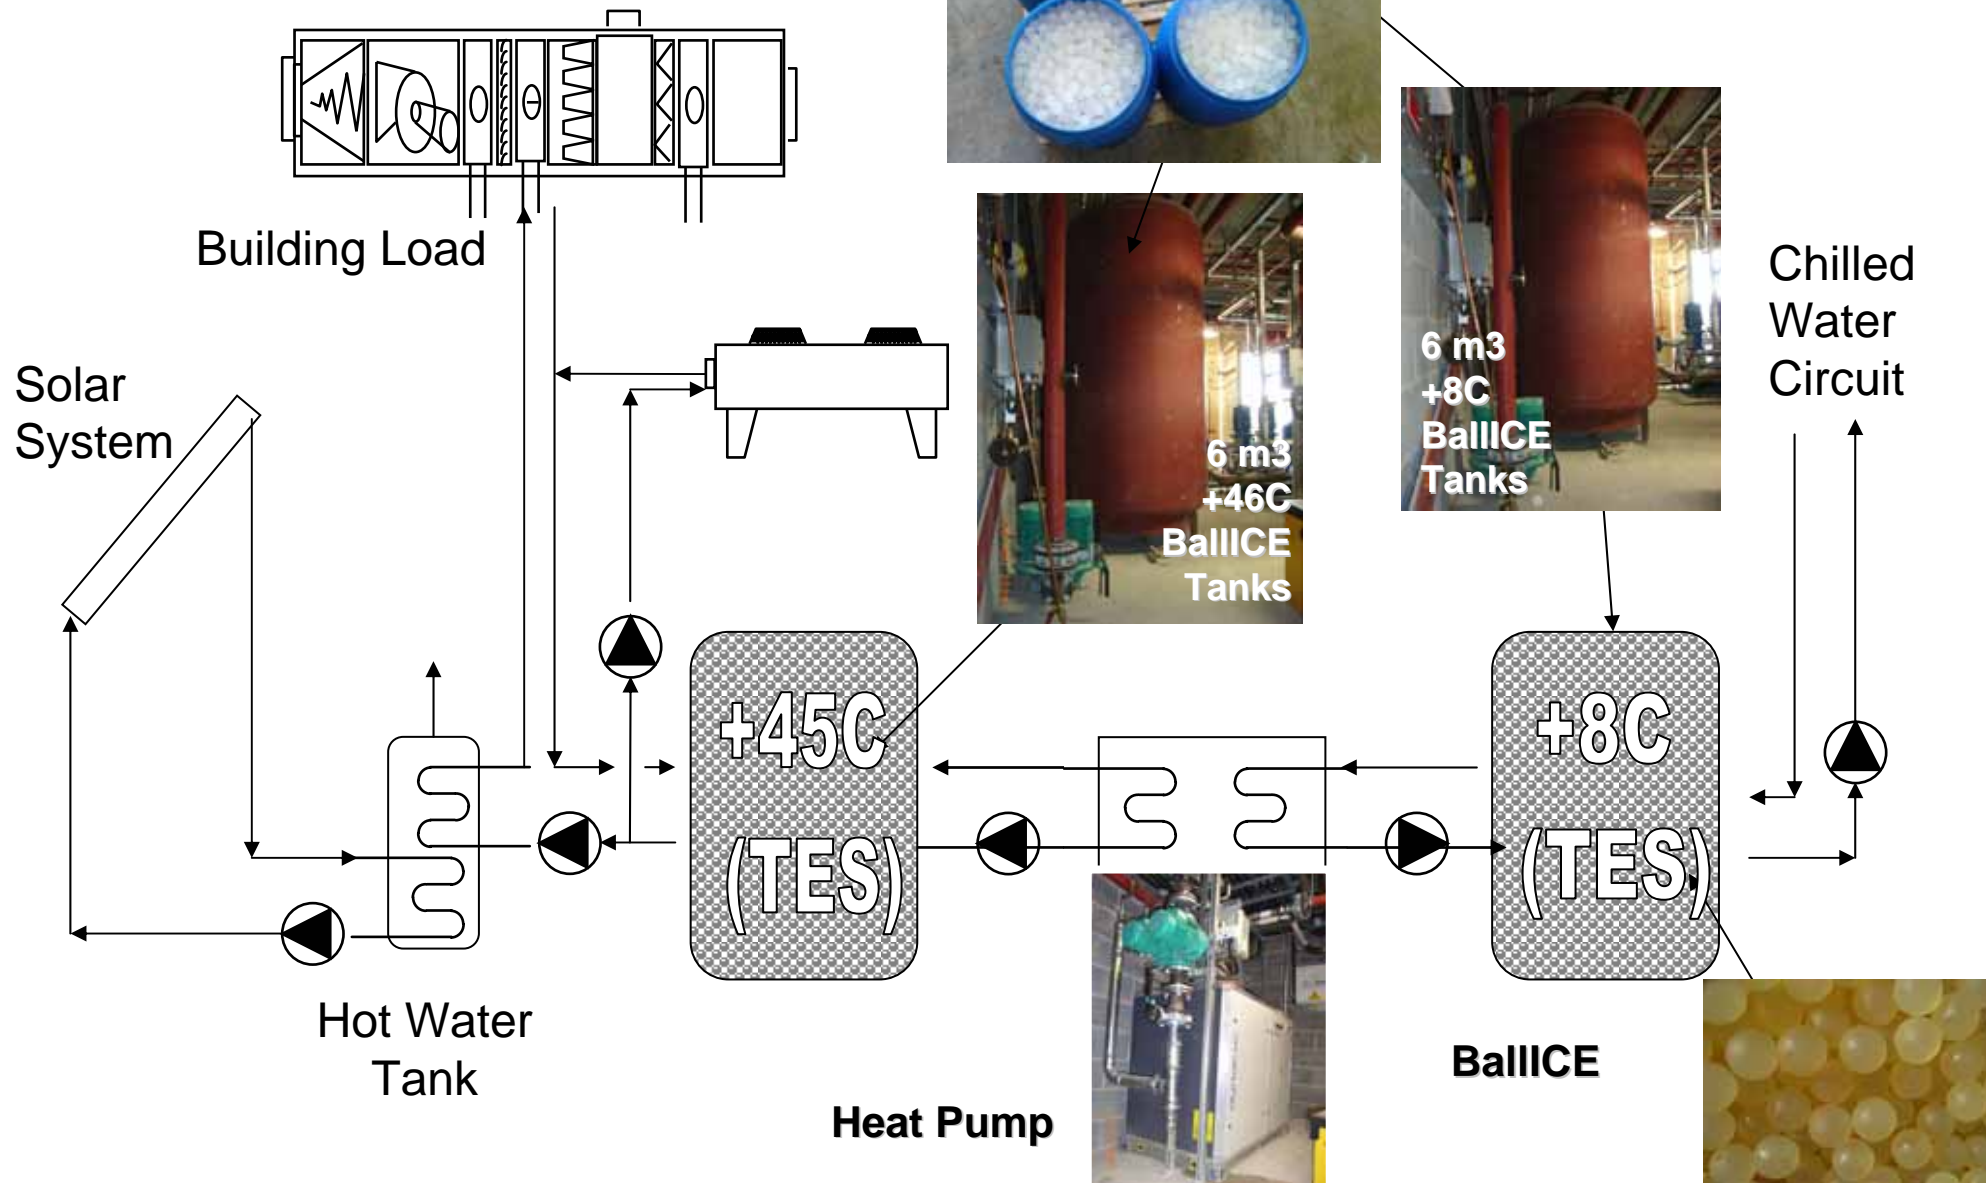

HEAT STORAGE

6m³, +45C

300 kWh

TES Tank

filled with

33,000

BallICE



CHILLED WATER STORAGE

6m³, +8C

300 kWh

TES Tank



filled with

33,000

BallICE



Outlet

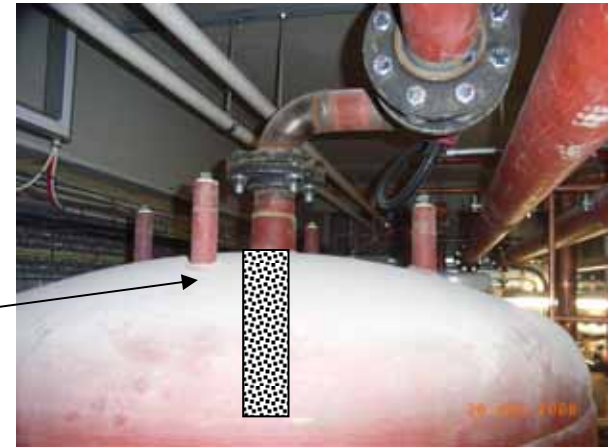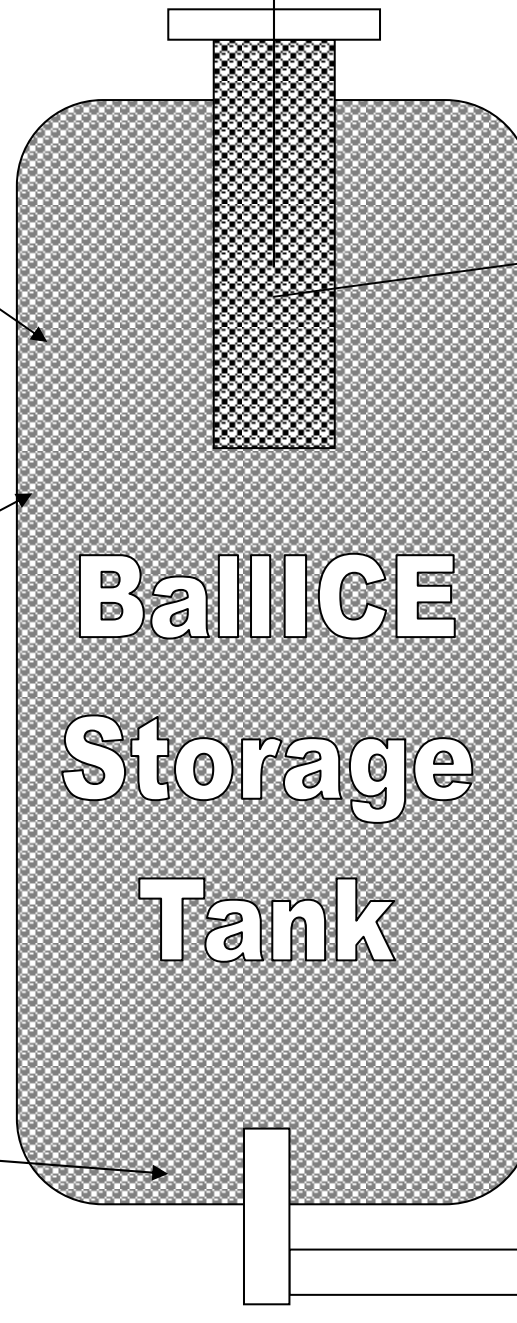

Inlet